



Panel instruments

General descriptions	4
Moving coil instruments	9
Moving coil instruments with rectifier.....	12
Moving coil instruments, special designs	14
Moving iron instruments	15
Maximum demand ammeters with bimetallic movements ..	17
Wattmeters with quadrant scale	18
Varmeters with quadrant scale	20
Wattmeters with circular scale	21
Varmeters with circular scale.....	23
Power factor meters.....	24
Watt-, Var-, Power factor meters, special designs	25
Frequency meters	26
Digital panel instruments	27
Position indicators	28
Synchronizing instruments.....	30
Instrument accessories	31
Dimensions	32
Scale types	34
Shunts	35

GENERAL DESCRIPTIONS

Standards

The electrical indicating instruments produced by Cewe Instrument comply with specifications IEC 60051, DIN 43802, DIN 43700, IEC 50081-1, IEC 50082-1, IEC 50081-2, IEC 50082-2, IEC 61010-1.

Panel instruments manufactured by Cewe Instrument are CE marked and produced in accordance to stated standards above.

Accuracy

The error of a indicating instrument can be divided into an intrinsic error and variations caused by external influence quantities. The intrinsic error consists of errors due to balance, friction or individual variations between instruments. The influence quantities are the ambient temperature, frequency, mounting position, external magnetic fields etc.

As a measure of the instrument's accuracy we use the concept accuracy class, defined in SS IEC 60051. The class index states a maximum intrinsic error under certain reference conditions of calibration temperature, mounting position etc. In most cases, error is expressed as a percentage of the upper limit of the measuring range. When zero is displaced within the scale, the error is taken as a percentage of the sum of the upper and lower limit of the measuring range, irrespective of sign. For non-linear scales the error is a percentage of the scale length.

Temperature range

Cewe Instrument indicating instruments are suitable for operation between -25°C and $+50^{\circ}\text{C}$.

Test voltage

All Cewe Instrument's instruments are subjected to a dielectric strength test of 4.3 kV, 50 Hz for 1 minute.

Current and voltage limits

Maximum direct connection current for quadrant scale narrow flange instruments is 60 A for the different types. For higher currents, please use current transformers or shunt respectively. Moving iron ammeters can take a 50-fold current of short duration and voltmeters twice the nominal voltage for a short period.

Housing

Instruments with a narrow flange have cases of polycarbonate.

Bearings

The movements have pivot bearings, with highly polished pivots of hardened steel and sapphire bearings.

Magnetic shielding

Cewe Instrument's instruments are well shielded and it is not necessary to state in which type of panel the meters will be mounted. In cubicles the moving iron instruments can be mounted in high magnetic fields. Our instruments are designed for these conditions.

Zero adjustment

Most instruments are fitted with a zero-setting knob, by which the zero position of the pointer can be adjusted.

Scales

Cewe Instrument's instruments have long scale length in relation to front flange dimensions. They are produced according to DIN 43 802 specifications with black text on a white dial.

The upper limit of the measuring range should preferably be chosen from the following numbers 1, 1.5, 2.5, 4, 6 or multiples or submultiples thereof.

Cewe Instrument produces indicating instruments with a number of different scale types as shown below:

The quadrant scale is the most common. The movement in the righthand corners well utilized. Scale deflection approx. 90° .

The circular scale utilizes the housing well; A long scale is obtained in relation to instrument size. Scale deflection approx. 240° .

Edgewise instruments are common in process and control instrumentation. Scales for these instrument can be horizontal or vertical.


Spring loaded bearing

Silicon oil bearing

3

Mounting position


Standard instruments are calibrated for a vertical mounting position. When other mounting positions are required, please state that on the order. The mounting position is related to the horizontal plane according to the figure.

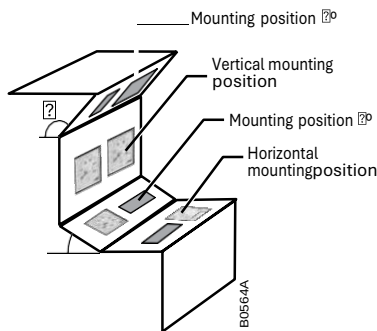

Orders for edgewise panel meters should always state whether a horizontal or vertical scale is required. Nominal range of use is $\pm 5^\circ$ from the given mounting position. The additional error in other mounting positions is very small.

Protection covers

To prevent unintentional contacts with the instrument terminals protection covers are available as an accessory for instruments with front flange dimensions 48 x 48, 72 x 72 and 96 x 96 mm. The cover is snapped onto the rear of the instrument after mounting and connecting the instrument leads.



Bumps and vibrations

Our instruments are constructed to withstand strain occurring in all normal applications. All standard design instruments withstand bumps with accelerations of 15 m/s^2 . In specifications for equipment to be used in areas where earthquakes occur, there are often bump and vibration withstand capability requirements on components. Cewe Instrument fulfil these requirements well.

Protection degree

Standard instruments are made according to IP 54. Rubber gasket to seal against panel can be obtained as an accessory.

Environmental protection


High relative humidity and corrosive environments in general, require good component quality and surface finish.

Standard design

Relative humidity max 95% for max 30 days per year.
Otherwise max 85%
Year average max 75%


Mounting of the instruments

The instruments are mounted with a snap-in mounting device as shown in the figure. This is a simple, reliable, and very time-saving method. There are no small screws or spring-clips to get lost.

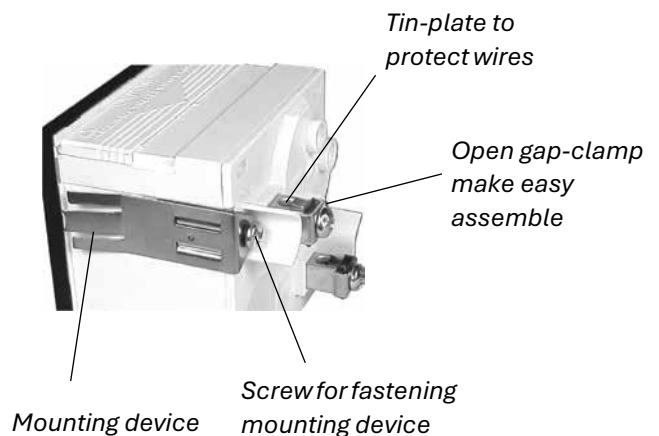

GENERAL DESCRIPTIONS

Moving iron instruments

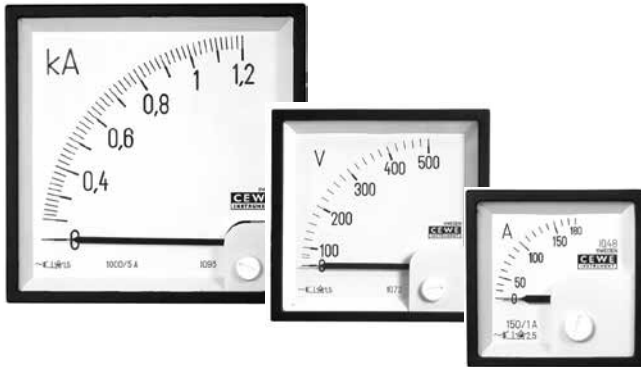


Cewe Instrument manufactures moving iron instruments with front flange dimensions 48 x 48, 72 x 72 and 96 x 96 mm, all with quadrant scales. These instruments are primarily used for the measurement of AC current and AC voltage.

Ammeters with a measuring range of 1 A and above are practically frequency independent up to approx. 400 Hz. Voltmeters with their more inductive coils are somewhat more frequency dependent and is designed for a frequency of 50 – 60 Hz.

If moving iron instruments should be used for measuring of DC quantities it always should be noted on the order. The measuring accuracy is, however somewhat effected by small error due to DC magnetization.

The moving iron instruments have a silicone damping system. The screw containing the sapphire of the bearing is filled with silicone oil and the spindle is thus damped in its movement. Measures are taken that the silicone oil

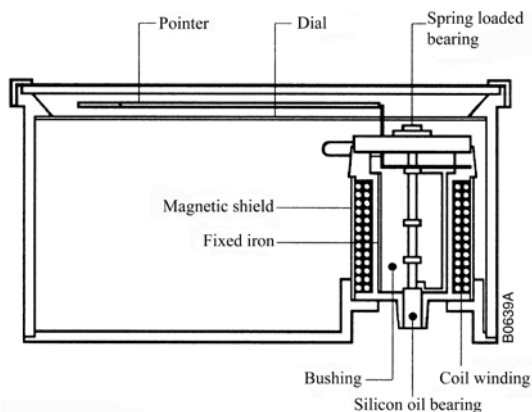

cannot creep out of the screw. The oil viscosity temperature coefficient is low and damping properties almost constant within the whole temperature range – 25° – + 50°C. By varying the viscosity of the oil, the damping properties can be chosen after application. Cewe Instruments moving iron instruments are high

torque (low effect on friction) and a linear scale from approx. 20% of the measuring range.

The power consumption for CT connected ammeters is 0.55 VA for 1 Amp CTs. and 0.65 VA for 5 Amp CTs.

Order information required:

1. Type of instrument, e.g. IQ 96.
2. Measuring range, e.g. 0 – 25 A.
3. Transformer when applicable e.g. 100/5 A.
4. Special design, e.g. red mark at 15 A

Order example:


2 pcs. IQ 72, 100/5 A scale 0 – 120 A. Red mark at 75 A.

Overload

- 1.2 x U_{IN} continuously, 2 x U_{IN} during 5 s,
- 2 x I_{IN} continuously, 10 x I_{IN} during 10 s.

Transformer connected moving iron ammeters withstand 50 x I_N 1 sec. characterized by low power consumption.

Maximum demand ammeters

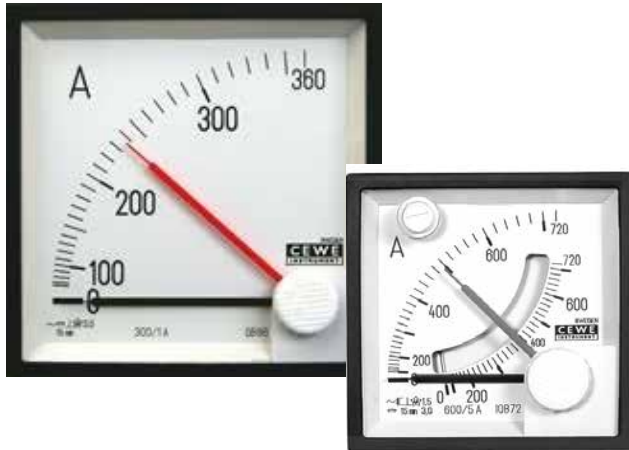

Maximum demand ammeters with bimetal movements are used for the supervision of thermal load in transformers, cables, motors etc. The thermal lag for the bimetal system is 15 minutes.

The torque of the meter movement is great and its black pointer can move a red slave pointer, the position of which indicates the highest average value of the current. The slave pointer can be returned to the position of the black pointer with a special re-set knob. The instrument can be connected to 5 A circuit, to a CT x/5 A or x/1 A. Upper limit of measuring range is 20% of rated value.


Maximum demand ammeters are also available in combination with a moving iron ammeter.

Overload

$2 \times I_{IN}$ continuously

$10 \times I_{IN}$ for 10 s

Moving coil instruments

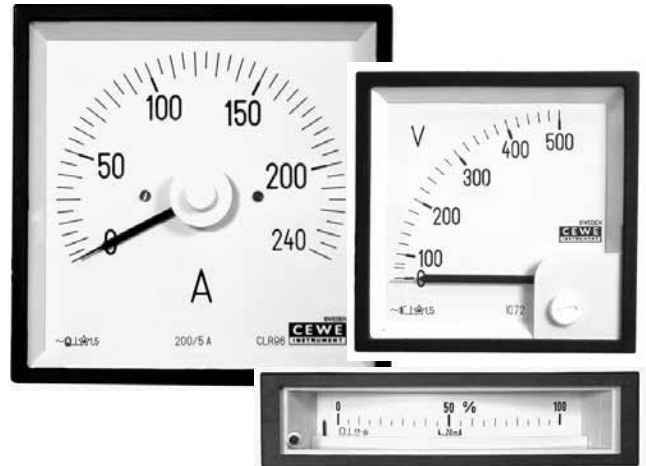

Moving coil instruments are used for measurement of DC current and DC voltage. The movements have low power consumption and an approximately linear scale. Provided with a rectifier, the moving-coil instruments can be used for the measurement of sinusoidal AC current and AC voltage. In this case, the movement is average sensing, but the scale is graduated in r.m.s. The moving coil rectifier instrument is used where there are requirements for low power consumption (a linear scale from zero) or for measurements at high or varying frequencies.

The standard voltmeters have 1 mA current consumption.

Millivoltmeters for connection to shunts are calibrated for a connection lead resistance of 0.035 Ω .

Cewe Instrument's moving coil instruments have pivot-bearings and high torque.

These instruments are of three different types:

1. Quadrant scale, 90° deflection, see page 34
2. Circular scale, 240° deflection, see page 34
3. Edgewise, 70° deflection, see page 34

Information required with order:

1. Type of instrument, e.g. CQ 96
2. Measuring range, e.g. 0 – 250 V
3. Shunt data when applicable, e.g. 100 A, 60 mV

Order example:


1 pcs CL 96, 0 – 20 mA, scale 0 – 250 kW, red mark at 200 kW.

Overload

$1.2 \times U_{IN}$ continuously, $2 \times U_{IN}$ during 5 s,

$2 \times I_{IN}$ continuously, $10 \times I_{IN}$ during 10 s.

Frequency meters

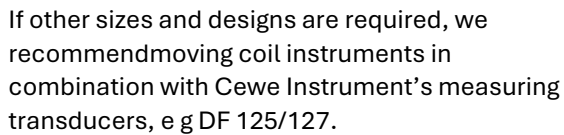

1.2 x U_{IN} continuously, 2 x U_{IN} during 5 s,
2 x I_{IN} continuously, 10 x I_{IN} during 10 s.

MOVING COIL INSTRUMENTS



Type		CQ 48	CQ 72	CQ 96
Front flange	mm	49 x 49 ¹⁾	72 x 72	96 x 96
Housing	mm	45 x 45	67 x 67	91 x 91
Scale		linear	linear	linear
Scale length	mm	34	67	103
Class		2.5	1.5	1.5
Response time	sec	1	1	1
Test voltage	V~	4300	4300	4300
Weight	kg	0.12	0.16	0.20

1) Mosaic performance for 48x48 on request.

Ammeters

Measurin grange	CQ 48	CQ 72	CQ 96
	2) U ca mV ³⁾		
1 mA	55	55	55
10 mA	30	30	30
15 mA	60	60	60
20 mA	60	60	60
4-20 mA	60	60	60
25 mA	60	60	60
40 mA	60	60	60
60 mA	60	60	60
100 mA	60	60	60
150 mA	60	60	60
250 mA	60	60	60
400 mA	60	60	60
600 mA	60	60	60
1 A	60	60	60
1,5 A	60	60	60
2,5 A	60	60	60
4 A	60	60	60
6 A	60	60	60
10 A	60	60	60
15 A	60	60	60
25 A	60	60	60
Sep. snunt 4)	60	60	60

Voltmeters


Measurin grange	CQ 48	CQ 72	CQ 96
	Ri ca 2)/V ⁴⁾		
60 mV	500	500	500
100 mV	500	500	500
150 mV	500	500	500
250 mV	500	500	500
400 mV	1000	1000	1000
600 mV	1000	1000	1000
1 V	1000	1000	1000
1.5 V	1000	1000	1000
2.5 V	1000	1000	1000
4 V	1000	1000	1000
6 V	1000	1000	1000
10 V	1000	1000	1000
15 V	1000	1000	1000
25 V	1000	1000	1000
40 V	1000	1000	1000
60 V	1000	1000	1000
100 V	1000	1000	1000
150 V	1000	1000	1000
250 V	1000	1000	1000
400 V	1000	1000	1000
500 V	1000	1000	1000
600 V	1000	1000	1000

2) Voltage drop $\pm 1.5\%$. Current consumption approx 2 mA.

3) The VA consumption, $\pm 5\%$, for A-meters is obtained by multiply actual 2) U from above table with actual current.

4) The VA consumption, $\pm 5\%$, for V-meters is obtained by multiply actual voltage from above table with 2 mA for 60 - 250 mV and 1 mA for other.

Wiring diagram



MOVING COIL INSTRUMENTS



Type		CL 48	CL 72	CL 96
Front flange	mm	49 x 49 ¹⁾	72 x 72	96 x 96
Housing	mm	45 x 45	67 x 67	91 x 91
Scale		linear	linear	linear
Scale length	mm	67	110	151
Class		1.5	1.5	1.5
Response time	sec	1	1	1
Test voltage	V~	4300	4300	4300
Weight	kg	0.25	0.25	0.30

1) Mosaic performance for 48x48 on request.

Ammeters

Measuring range	CL 48	CL 72	CL 96
	$\approx U_{ca} \text{ mV}^3)$		
1 mA	345	345	345
10 mA	80	80	80
20 mA	80	80	80
4-20 mA	80	80	80
25 mA	150	150	150
40 mA	150	150	150
60 mA	150	150	150
100 mA	150	150	150
150 mA	150	150	150
250 mA	150	150	150
400 mA	150	150	150
600 mA	150	150	150
1 A	150	150	150
1.5 A	150	150	150
2.5 A	150	150	150
4 A	—	—	150
6 A	—	—	150
10 A	—	—	150
15 A	—	—	150
25 A	—	—	150
Sep. shunt 2)	(60)150	(60)150	(60) 150

2) Voltage drop $\pm 1.5\%$. current consumption approx 6.6 mA.


3) The VA consumption, $\pm 5\%$, for A-meters is obtained by multiply actual $\approx U$ from above table with actual current.

Voltmeters

Measuring range	CL 48	CL 72	CL 96
	$R_i \text{ ca } \approx V^4)$		
60 mV	100	100	100
100 mV	100	100	100
150 mV	100	100	100
250 mV	100	100	100
400 mV	100	100	100
600 mV	100	100	100
1 V	1000	1000	1000
1.5 V	1000	1000	1000
2.5 V	1000	1000	1000
4 V	1000	1000	1000
6 V	1000	1000	1000
10 V	1000	1000	1000
15 V	1000	1000	1000
25 V	1000	1000	1000
40 V	1000	1000	1000
60 V	1000	1000	1000
100 V	1000	1000	1000
150 V	1000	1000	1000
250 V	1000	1000	1000
400 V	1000	1000	1000
500 V	1000	1000	1000
600 V	—	—	1000

4) The VA consumption, $\pm 5\%$, for V-meters is obtained by multiply actual voltage from above table with 10 mA for 60 - 600 mV and 1 mA for other.

Wiring diagram



MOVING COIL INSTRUMENTS



Type		MP 48x24	MP 72x24	P 96 PrS
Front flange	mm	48 x 24	72 x 24	96 x 48
Housing	mm	43 x 17 x 75	66 x 17 x 98	91 x 43 x 107
Cut out	mm	45 x 22.2	68 x 22.2	92 x 45
Scale		linear	linear	linear
Scale length	mm	32	52	67
Class		1.5	1.5	1.5
Response time	sec	1	1	1
Test voltage	V~	4300	4300	4300
Weight	kg	0.1	0.2	0.45

Ammeters

Measurin grange	MP 48x24	MP 72x24	P 96 PrS
	$R^2 U$ ca mV 2)		
100 μ A	1000 Ω	680 Ω	4900 Ω
150 μ A	835 Ω	480 Ω	3600 Ω
250 μ A	500 Ω	300 Ω	2200 Ω
400 μ A	310 Ω	205 Ω	1300 Ω
600 μ A	210 Ω	110 Ω	250 Ω
1 mA	32 mV	31 Ω	48 Ω
1.5 mA	46 mV	24 Ω	60 mV
2.5 mA	46 mV	20 Ω	60 mV
4 mA	46 mV	17 Ω	60 mV
6 mA	46 mV	60 mV	60 mV
10 mA	46 mV	60 mV	60 mV
15 mA	46 mV	60 mV	60 mV
20 mA	46 mV	60 mV	60 mV
4-20 mA	46 mV	60 mV	60 mV
25 mA	46 mV	60 mV	60 mV
40 mA	46 mV	60 mV	60 mV
60 mA	46 mV	60 mV	60 mV
100 mA	46 mV	60 mV	60 mV
150 mA	46 mV	60 mV	60 mV
250 mA	46 mV	60 mV	60 mV
400 mA	46 mV	60 mV	60 mV
600 mA	46 mV	60 mV	60 mV
1 A	46 mV	60 mV	60 mV
Sep. shunt 1)	60 mV	60 mV	60 mV

1) Voltage drop $\pm 1.5\%$

2) The VA consumption, $\pm 5\%$, for A-meters is obtained by multiply actual $R^2 U$ from above table with actual current or as the case actual $R^2 \times I$ from table.


Other versions on request.

Voltmeters

Measurin grange	MP 48x24	MP 72x24	P 96 PrS
	R_i ca Ω/V		
1 V	1000	1000	1000
1.5 V	1000	1000	1000
2.5 V	1000	1000	1000
4 V	1000	1000	1000
6 V	1000	1000	1000
10 V	1000	1000	1000
15 V	1000	1000	1000
25 V	1000	1000	1000
40 V	1000	1000	1000
60 V	1000	1000	1000
100 V	1000	1000	1000
150 V	1000	1000	1000
250 V	1000	1000	1000
400 V	1000	1000	1000
500 V	1000	1000	1000
600 V	1000	1000	1000

The VA consumption, $\pm 5\%$, for V-meters is obtained by multiply actual voltage from above table with 1 mA.

Wiring diagram

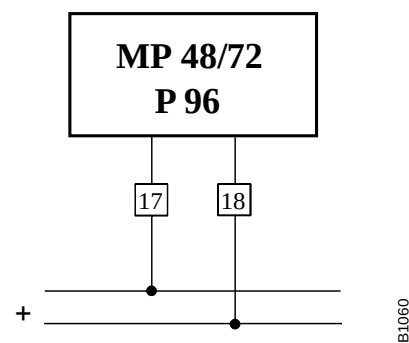

B1060

MOVING COIL INSTRUMENTS WITH RECTIFIER



Type		CQR 48	CQR 72	CQR 96
Front flange	mm	49 x 49 ¹⁾	72 x 72	96 x 96
Housing	mm	45 x 45	67 x 67	91 x 91
Scale		linear	linear	linear
Scale length	mm	34	67	103
Class		2.5	1.5	1.5
Response time	sec	1	1	1
Test voltage	V~	4300	4300	4300
Weight	kg	0.13	0.17	0.37

Moving coil instruments with rectifier are intended for sinusoidal AC 40 – 10.000 Hz. Measuring ranges from 25 V upwards have a linear deflection. Ranges below 25 V have the first part of the scale slightly compressed.

1) Mosaic performance for 48x48 on request.

Ammeters

Measuring range	CQR 48	CQR 72	CQR 96
	$\frac{U}{I} \text{ ca } V^3)$		
1 mA	1,3	1,3	1,3
10 mA	1,4	1,4	1,4
1 A	0,1	0,1	0,1
1.2 A	0,1	0,1	0,1
5 A	0,05	0,05	0,05
6 A	0,05	0,05	0,05
X/1 A ²⁾	0,1	0,1	0,1
X/5 A ²⁾	0,05	0,05	0,05

2) For instrument transformer, transformer data to be given.

3) The VA consumption, $\pm 5 \%$, for A-meters is obtained by multiplying actual $\frac{U}{I}$ from above table with actual current.


Voltmeters

Measuring range	CQR 48	CQR 72	CQR 96
	$R_i \text{ ca } \Omega/V^4)$		
25 V	1000	1000	1000
40 V	1000	1000	1000
60 V	1000	1000	1000
100 V	1000	1000	1000
150 V	1000	1000	1000
250 V	1000	1000	1000
400 V	1000	1000	1000
500 V	–	1000	1000
600 V	–	1000	1000
X/110V ²⁾	1000	1000	1000

2) For instrument transformer, transformer data to be given.

4) The VA consumption, $\pm 5 \%$, for V-meters is obtained by multiplying actual voltage from above table with 1 mA.

Wiring diagram

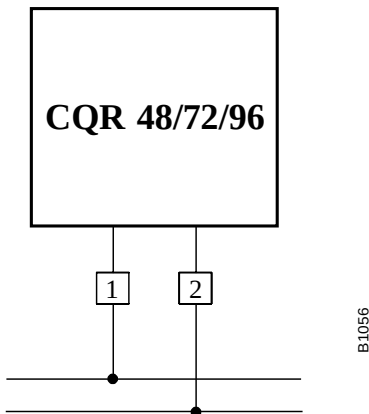

MOVING COIL INSTRUMENTS WITH RECTIFIER



Type		CLR 48	CLR 72	CLR 96
Front flange	mm	49 x 49 ¹⁾	72 x 72	96 x 96
Housing	mm	45 x 45	67 x 67	91 x 91
Scale length	mm	67	110	151
Class		2.5	1.5	1.5
Response time	sec	1	1	1
Test voltage	V~	4300	4300	4300
Weight	kg	0.3	0.3	0.35

1) Mosaic performance for 48x48 on request.

Ammeters

Measuring range	CLR 48	CLR 72	CLR 96
	$\frac{U}{I} \text{ ca } V^3)$		
1 mA	1.3	1.3	1.3
10 mA	1.4	1.4	1.4
1 A	0.1	0.1	0.1
1.2 A	0.1	0.1	0.1
5 A	0.05	0.05	0.05
6 A	0.05	0.05	0.05
X/1 A ²⁾	0.1	0.1	0.1
X/5 A ²⁾	0.05	0.05	0.05

2) For instrument transformer, transformer data to be given.

3) The VA consumption, $\pm 5\%$, for A-meters is obtained by multiplying actual $\frac{U}{I}$ from above table with actual current.


Voltmeters

Measuring range	CLR 48	CLR 72	CLR 96
	$R_i \text{ ca } \Omega/V^4)$		
25 V	1000	1000	1000
40 V	1000	1000	1000
60 V	1000	1000	1000
100 V	1000	1000	1000
150 V	1000	1000	1000
250 V	1000	1000	1000
400 V	1000	1000	1000
500 V	1000	1000	1000
600 V	—	—	1000
X/110V ²⁾	1000	1000	1000

2) For instrument transformer, transformer data to be given.

4) The VA consumption, $\pm 5\%$, for V-meters is obtained by multiplying actual voltage from above table with 1 mA.

Wiring diagram

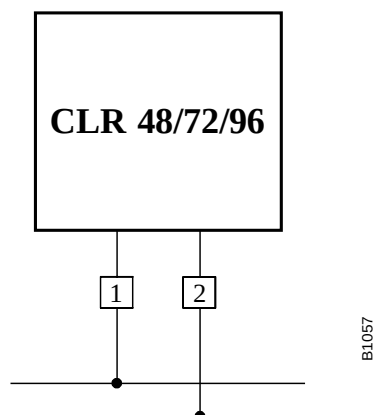

MOVING COIL INSTRUMENTS, SPECIAL DESIGNS

Special designs

Movement

- Non-standard mounting position (see page 5)
- Zero displaced within scale
- Accuracy class 1.0

Scale

- Red mark at a special value
- Colour field
- Double figures
- Double divisions
- Non-standard graduation (On request)
- Calibration according to graph or table
- Extra text on scale

MOVING IRON INSTRUMENTS



Type		IQ 48	IQ 72	IQ 96
Front flange	mm	49 x 49 ¹⁾	72 x 72	96 x 96
Housing	mm	45 x 45	67 x 67	91 x 91
Class		2.5	1.5	1.5
Scale length	mm	34	67	103
Frequency range	Hz	15-100	15-100	15-100
Test voltage	V~	4300	4300	4300
Weight	kg	0.10	0.15	0.22

1) Mosaic performance for 48x48 on request.

Ammeters

Measuring range	IQ 48	IQ 72	IQ 96
	$I_{ca} \text{ mA}^{3)}$		
300 mA	–	2000	–
1 A	800	800	800
2.5 A	330	330	–
4 A	–	–	200
6 A	130	130	130
10 A	130	130	130
15 A	80	80	80
25 A	55	55	55
40 A	–	30	30
60 A	–	40	40
X/1 A ²⁾	550	550	550
X/5 A ²⁾	130	130	130

Scales are manufactured with 20% overrange e. g. CT 100/5 A, scale 0-120 A.

Instruments can also be made for 2, 3 or 5 times overload.

- 2) For instrument transformer, transformer data to be given.
 3) The VA consumption, $\pm 5\%$, for A-meters is obtained by multiply actual I_{ca} from above table with actual current.


Voltmeters

Measuring range	IQ 48	IQ 72	IQ 96
	$R_i \text{ ca } \Omega/V^{4)}$		
60 V	35	35	35
100 V	40	40	40
150 V	50	50	50
250 V	90	90	90
300 V	–	–	90
400 V	150	150	150
500 V	150	150	150
600 V	–	150	150
800 V	–	200	200
X/100 V ²⁾	40	40	40
X/110 V ²⁾	40	40	40

Other voltage ranges on request.

- 2) For instrument transformer, transformer data to be given.
 4) The VA consumption, $\pm 5\%$, for V-meters is obtained by multiply actual voltage range with corresponding R_i/V , then divide actual U^2 with above calculated R_i . [$P=U^2/R$].

Wiring diagram

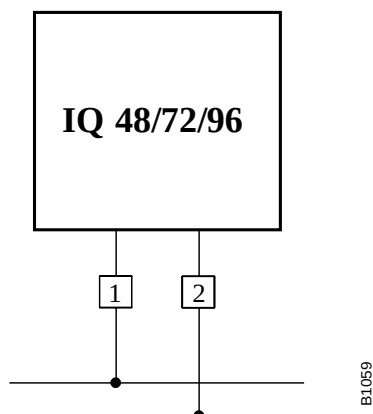

MOVING IRON INSTRUMENTS

Special designs

Movement

- Non-standard mounting position (see page 5)
- Accuracy class 1.0 for Size 72x72 and 96x96
- Accuracy class 1.5 for Size 48x48

Scale

- Red mark at a special value
- Color field
- Double figures
- Double divisions
- Calibration according to graph or table (On request)
- Extra text on scale
- Overload scale

MAXIMUM DEMAND AMMETERS WITH BIMETALLIC MOVEMENTS



QB 96



IQB 72

Maximum demand ammeters QB 48, QB 72 and QB 96 have a bi-metal movement with a thermal lag of 15 minutes. Types IQB 72 and IQB 96 contain the same movement and also moving iron movement.

Type		QB 48	QB 72	IQB 72	QB 96	IQB 96
Front flange	mm	49 x 49 ¹⁾	72 x 72	72 x 72	96 x 96	96 x 96
Housing	mm	45 x 45	67 x 67	67 x 67	91 x 91	91 x 91
Scale length, moving iron movement	mm	–	–	43	–	68
Scale length, bi-metallic movement	mm	37	67	67	103	103
Class:						
moving iron movement		–	–	1.5	–	1.5
bi-metallic movement –20 – +40°C		3	3	3	3	3
Angle of deflection:						
moving iron movement		–	–	80°	–	81°
bi-metallic movement		90°	90°	90°	90°	90°
Power consumption:						
moving iron at 1 and 5 A	VA	–	–	0.6	–	0.6
bi-metallic at 1 and 5 A	VA	1.5	1.5	1.5	1.5	1.5
Setting time:						
moving iron	sek	–	–	1	–	1
bi-metallic	min	15	15	15	15	15
Frequency range	Hz	15-100	15-100	15-100	15-100	15-100
Test voltage	V ~	4300	4300	4300	4300	4300
Weight	ca kg	0.22	0.25	0.35	0.33	0.40

1) Mosaic performance for 48x48 on request.

Wiring diagram


Special designs

Movement

- Non-standard mounting position (see page 5)
- Accuracy class 1.0 in moving iron movement

Scale

- Red mark at a special value
- Color field
- Overload for moving iron scale

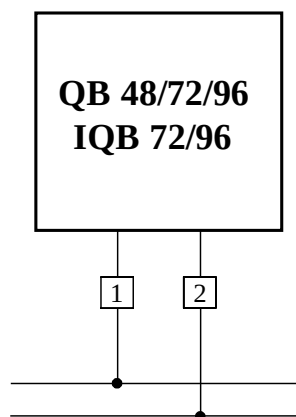

WATTMETERS WITH QUADRANT SCALE



Type		PQ 12	PQ 13	PQ 14
Front flange	mm	96 x 96	96 x 96	96 x 96
Housing	mm	91 x 91	91 x 91	91 x 91
Scale length	mm	103	103	103
Class		1.5	1.5	1.5
Frequency range	Hz	40-65	40-65	40-65
Response time	sec	1	1	1
Power consumption:				
Current circuit at 5 A	VA	0.4	0.4	0.4
Voltage circuit at 110 V	VA	1.0	1.0	1.0
Test voltage	V~	4300	4300	4300
Weight	kg	0.6	0.6	0.6

Usually made for		
Nominal current	A	5
Nominal voltage	V	PQ 12, PQ 13: 100, 110, 230, 400, 500
Nominal voltage	V	PQ 14: 100/57, 110/63,5, 230/130, 400/230, 500/290
The instruments can also be made for currents		A
		1, 2, 10


Can be ordered for one or two current directions.

Measuring range is limited by:	Scale power (W)	= min 0.5 – max 1.5
	Nominal power (W)	

Wiring diagrams


PQ 12

Single-phase AC

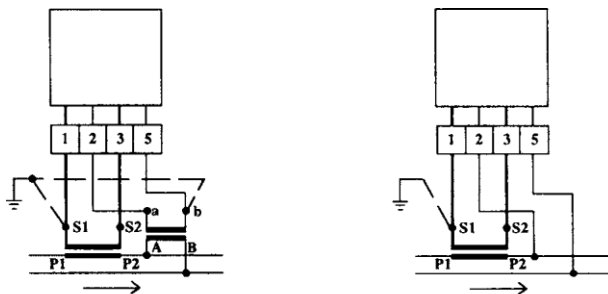


PQ 13

3-phase, 3-wire balanced load.

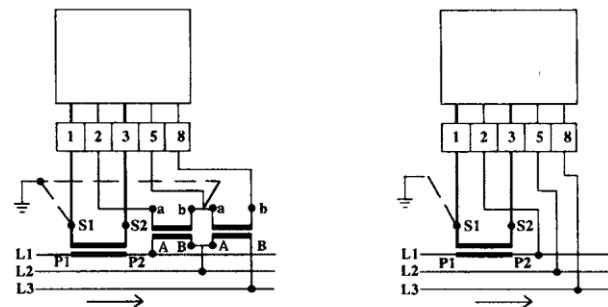

PQ 14

3-phase, 4-wire balanced load.

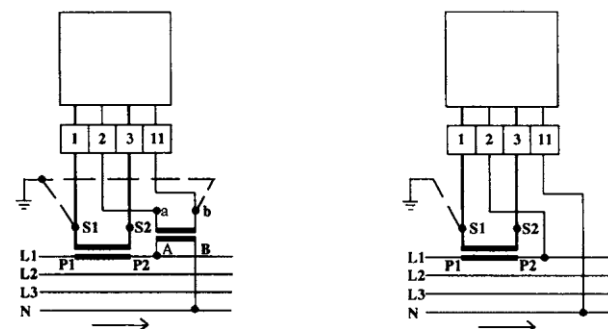

WATTMETERS WITH QUADRANT SCALE



Type		PQ 23	PQ 33	PQ 34
Front flange	mm	96 x 96	96 x 96	96 x 96
Housing	mm	91 x 91	91 x 91	91 x 91
Scale length	mm	103	103	103
Class		1.5	1.5	1.5
Frequency range	Hz	40-65	40-65	40-65
Response time	sec	1	1	1
Power consumption:				
Current circuit at 5 A	VA	0.4	0.4	0.4
Voltage circuit at 110 V	VA	1.0	1.0	1.0
Test voltage	V~	4300	4300	4300
Weight		0.6	0.6	0.6

Usually made for		
Nominal current	A	5
Nominal voltage	V	PQ 23: 100, 110, 230, 400, 500
Nominal voltage	V	PQ 33-34: 100/57, 110/63,5, 230/130, 400/230, 500/290
The instruments can also be made for currents		A
		1, 2, 10


Can be ordered for one or two current directions.

Measuring range is limited by: $\frac{\text{Scale power (W)}}{\text{Nominal power (W)}} = \min 0.5 - \max 1.5$

Wiring diagrams


PQ 23

3-phase, 3-wire unbalanced load.

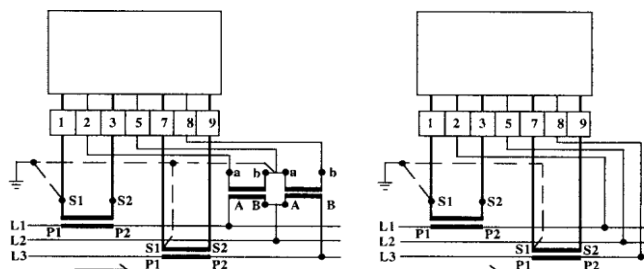


PQ 33

3-phase, 4-wire unbalanced load, without neutral.

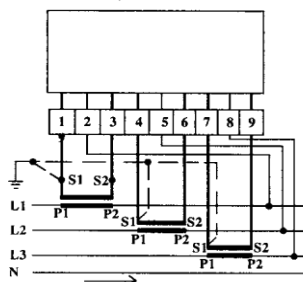

PQ 34

3-phase, 4-wire unbalanced load, with neutral

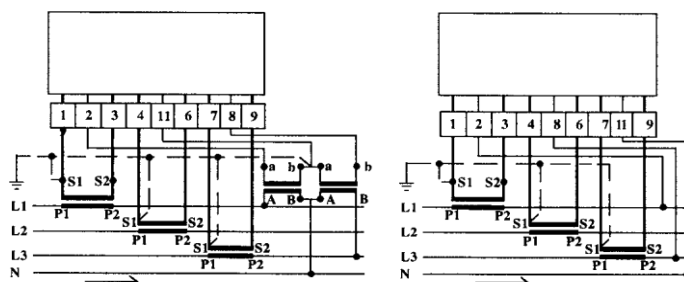

VARMETERS WITH QUADRANT SCALE



Type		QQ 13	QQ 23	QQ 33
Front flange	mm	96 x 96	96 x 96	96 x 96
Housing	mm	91 x 91	91 x 91	91 x 91
Scale length	mm	103	103	103
Class		1.5	1.5	1.5
Frequency range	Hz	40-65	40-65	40-65
Response time	sec	1	1	1
Power consumption:				
Current circuit at 5 A	VA	0.4	0.4	0.4
Voltage circuit at 110 V	VA	1.0	1.0	1.0
Test voltage	V~	4300	4300	4300
Weight	kg	0.6	0.6	0.6

Usually made for

Nominal current	A	5
Nominal voltage	V	QQ 13, QQ 23: 100, 110, 230, 400, 500
Nominal voltage	V	QQ 33: 100/57, 110/63,5, 230/130, 400/230, 500/290
The instruments can also be made for currents	A	1, 2, 10


Can be ordered for one or two current directions.

Measuring range is limited by:	Scale power (W)	= min 0.5 – max 1.5
	Nominal power (W)	

Wiring diagrams


QQ 13

3-phase, 3-wire balanced load..

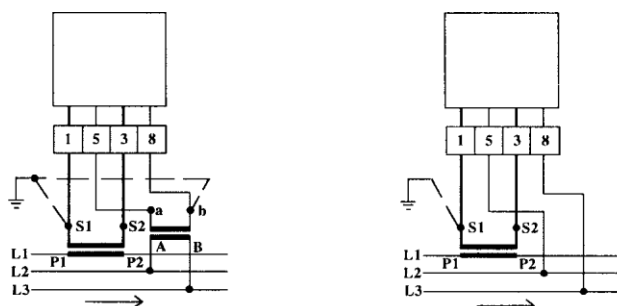


QQ 23

3-phase, 3-wire unbalanced load.

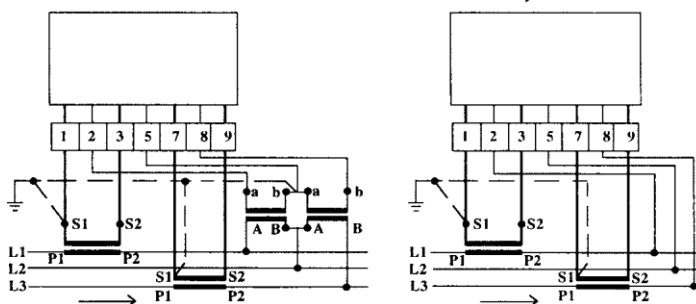

QQ 33

3-phase, 4-wire unbalanced load.

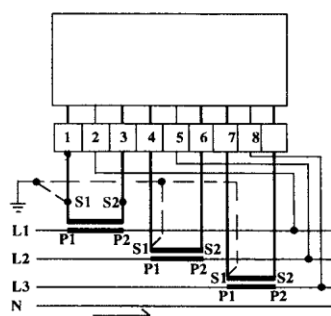

WATTMETERS WITH CIRCULAR SCALE



Type		PL 12	PL 13	PL14
Front flange	mm	96 x 96	96 x 96	96 x 96
Housing	mm	91 x 91	91 x 91	91 x 91
Scale length	mm	151	151	151
Class		1.5	1.5	1.5
Frequency range	Hz	40-65	40-65	40-65
Response time	sec	1	1	1
Power consumption:				
Current circuit at 5 A	VA	0.4	0.4	0.4
Voltage circuit at 110 V	VA	1.0	1.0	1.0
Test voltage	V~	4300	4300	4300
Weight	kg	0.6	0.6	0.6

Usually made for		
Nominal current	A	5 or 1
Nominal voltage	V	PL 12, PL 13: 100, 110, 230, 400, 500
Nominal voltage	V	PL 14: 100/57, 110/63,5, 230/130, 400/230, 500/290


Can be ordered for one or two current directions.

Measuring range is limited by:	Scale power (W)	= min 0.5 – max 1.5
	Nominal power (W)	

Wiring diagrams


PL 12

Single-phase AC

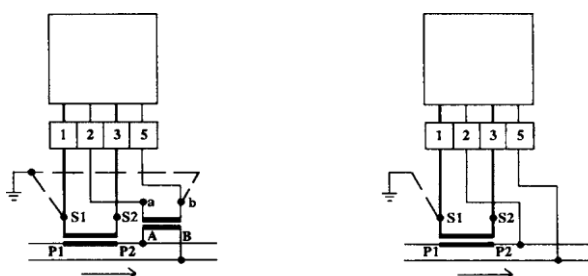


PL 13

3-phase, 3-wire balanced load.

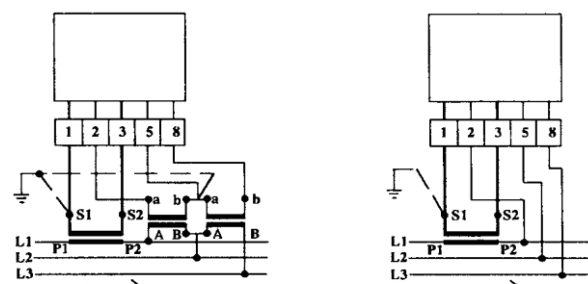

PL 14

3-phase, 4-wire balanced load.

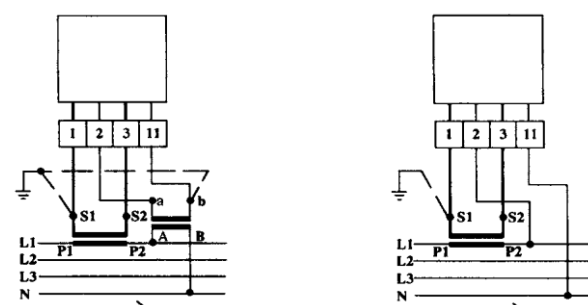

WATTMETERS WITH CIRCULAR SCALE



Type		PL 23	PL 33	PL 34
Front flange	mm	96 x 96	96 x 96	96 x 96
Housing	mm	91 x 91	91 x 91	91 x 91
Scale length	mm	151	151	151
Class		1.5	1.5	1.5
Frequency range	Hz	40-65	40-65	40-65
Response time	sec	1	1	1
Power consumption:				
Current circuit at 5 A	VA	0.4	0.4	0.4
Voltage circuit at 110 V	VA	1.0	1.0	1.0
Test voltage	V~	4300	4300	4300
Weight		0.6	0.6	0.6


Usually made for	
Nominal current	A 5 or 1
Nominal voltage	V PL 23: 100, 110, 230 400, 500
Nominal voltage	V PL 33, PL 34: 100/57, 110/63,5, 230/130, 400/230, 500/290

Can be ordered for one or two current directions.


	Scale power (W)
Measuring range is limited by:	= min 0.5 – max 1.5
	Nominal power (W)

Wiring diagrams


PL 23
3-phase, 3-wire unbalanced load.

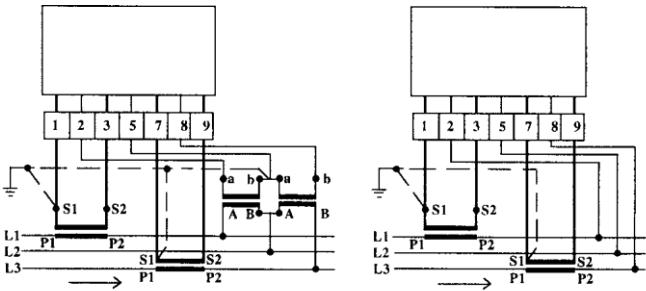

PL 33
3-phase, 4-wire unbalanced load, without neutral.

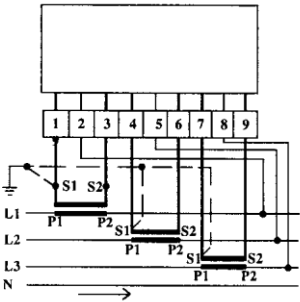

PL 34
3-phase, 4-wire unbalanced load, with neutral

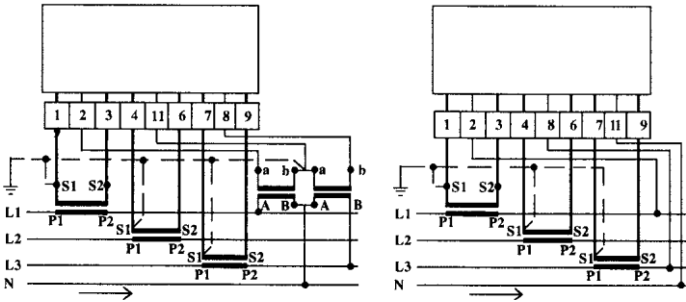

VARMETERS WITH CIRCULAR SCALE



Type		QL 13	QL 23	QL 33
Front flange	mm	96 x 96	96 x 96	96 x 96
Housing	mm	91 x 91	91 x 91	91 x 91
Scale length	mm	151	151	151
Class		1.5	1.5	1.5
Frequency range	Hz	40-65	40-65	40-65
Response time	sec	1	1	1
Power consumption:				
Current circuit at 5 A	VA	0.4	0.4	0.4
Voltage circuit at 110 V	VA	1.0	1.0	1.0
Test voltage	V~	4300	4300	4300
Weight	kg	0.6	0.6	0.6

Usually made for		
Nominal current	A	5 or 1
Nominal voltage	V	QL 13, QL 23: 100, 110, 230, 400, 500
Nominal voltage	V	QL 33: 100/57, 110/63,5, 230/130, 400/230, 500/290


Can be ordered for one or two current directions.

Measuring range is limited by:	Scale power (W)	
	Nominal power (W)	= min 0.5 – max 1.5

Wiring diagrams


QL 13

3-phase, 3-wire balanced load..

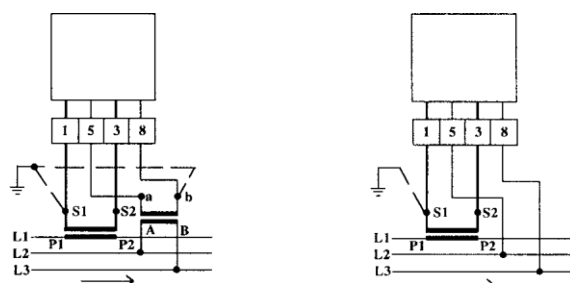


QL 23

3-phase, 3-wire unbalanced load.

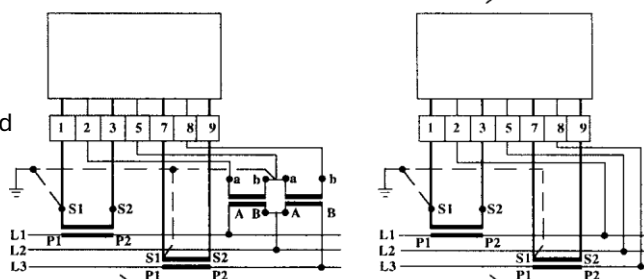

QL 33

3-phase, 4-wire unbalanced load.

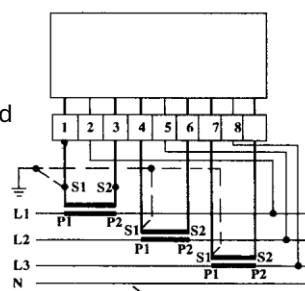

POWER FACTOR METERS



LSC





PFQ

Type		LSC96KD/PFQ 13
Front flange	mm	96 x 96
Housing	mm	90x90/91x91
Scale length	mm	142/103
Class		1.5
Frequency range	Hz	40-65
Inställningstid	ca sec	1
Power consumption:		
Current cicuit at 5 A	ca VA	0,1/1,3
Voltage cicuit at 110 V	ca VA	3,0/0,8
Test voltage	V~	4300
Weight	ca kg	0,55/0,42

Usually made for	
Nominal current	A 1, 2, 5
Nominal voltage	V 110, 230, 400, 500
Scale CAP-IND	0.5 – 1 – 0.5

Wiring diagrams

LSC 96KD/PFQ 13
3-phase, 3-wire
balancedload.

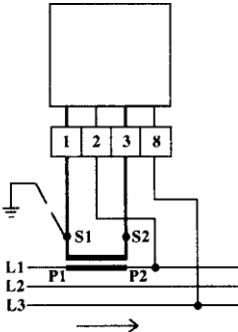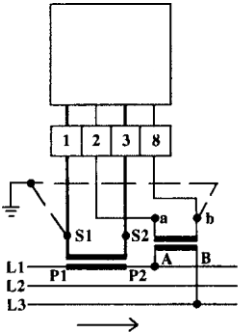

Special designs

Movement

- Non-standard mounting position (see page 5)
- Zero displaced within scale

Scale

- Red mark at a special value
- Colour field
- Double figures
- Double divisions
- Non-standard graduation (On request)
- Extra text on scale

FREQUENCY METERS




Typ		FQ 72	FQ 96	FL 96
Front flange	mm	72 x 72	96 x 96	96 x 96
Housing	mm	67 x 67	91 x 91	91 x 91
Scale		linear	linear	linear
Scale length	mm	67	103	151
Class		1.5	1.5	1.5
Power consumption	mA	10	10	10
Response time	sec	2	2	2
Test voltage	V~	4300	4300	4300
Weight	kg	0.16	0.2	0.3

The VA consumption is obtained by multiply actual input voltage from below table with current consumption 10 mA as per above table.

Voltage	Measuring range
110 V	46 – 54 Hz 56 – 64 Hz
230 V	46 – 54 Hz 56 – 64 Hz
400 V	46 – 54 Hz 56 – 64 Hz

Wiring diagram

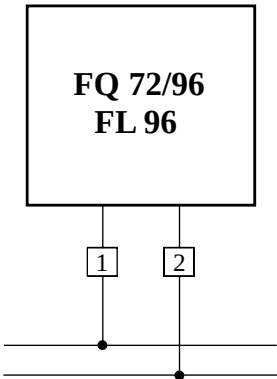

B1053

SYNCHRONIZING INSTRUMENTS



Pointer synchroscope



Double voltmeter




Double frequency meter

Type		SY 96 S	SY 144 S
Front flange	mm	96 x 96	144 x 144
Housing	mm	91 x 91	136 x 136
Class		1.0	1.0
Internal consumption: (Vid 100 V, 50 Hz)			
At main side:	VA	4	4
At generator side:	VA	0.7	0.7
Weight	ca kg	1.0	1.1
Rated voltage:	V	100	100
	V	110	110
	V	230	230
	V	400	400
	V	440	440

Type		WQ 96/2S	WQ 144/2S
Fläns	mm	96 x 96	144 x 144
Housing	mm	91 x 91	136 x 136
Scale length	mm	70	105
Class		1.5	1.5
Internal consumption per measuring system at 100 V			
	VA	1.8	2.5
Test voltage	V~	2000	2000
Weight	kg	1.2	1.5
Rated voltage	V	2 x X/100	2 x X/100
	V	2 x X/110	2 x X/110
	V	2 x 230	2 x 230
	V	2 x 400	2 x 400
	V	2 x 440	2 x 440

Type		FQ 96/2	FQ 144/2
Front flange	mm	96 x 96	144 x 144
Housing	mm	91 x 91	136 x 136
Class		0.5	0.5
Number of reeds		2 x 21	2 x 21
Internal consumption at 100 V			
	VA	1.1	1.1
Test voltage	V~	2000	2000
Weight	kg	0.6	1.0
Rated voltage	V	2 x 100	2 x 100
	V	2 x 110	2 x 110
	V	2 x 230	2 x 230
	V	2 x 400	2 x 400
	V	2 x 440	2 x 440
Measuring range	Hz	45 – 50 – 55	45 – 50 – 55
	Hz	55 – 60 – 65	55 – 60 – 65

Wiring diagrams

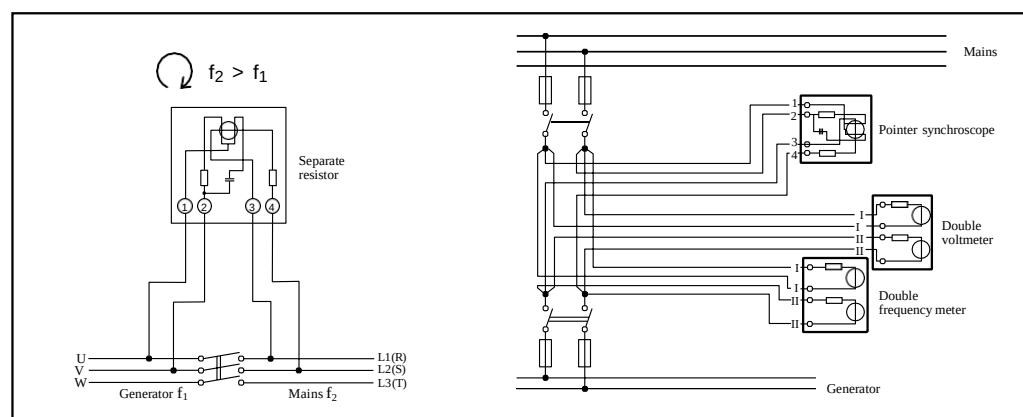

SYNCHRONIZING INSTRUMENTS, ACCESSORIES, OPTIONS

When an AC generator is to be connected to another generator or to the mains, voltage phase and frequency must coincide. By the measurement of these quantities the following three instruments can be used in combination.

A Pointer synchroscope

A circular scale instrument, with a shielded electrodynamic movement. The instrument indicates the phase difference between the three-phase systems. When generator frequency is lower than mains frequency, the pointer rotates counter-clockwise and at a higher frequency clockwise.

Wall brackets

For installation of synchronizing measuring instruments size 96 x 96 mm or 144 x 144 mm.

The bracket can be turned 180°.

Standard color grey RAL 7037 RAL

7032 or RAL 7035 on request

At an equal frequency the pointer does not move and the position corresponds to the phase difference. The two 3-phase systems can be connected when the pointer is in a vertical position pointing at the mark, if the voltages are equal at the same time.

B Double-voltmeter


The instrument is provided with two independent moving iron movements for voltage measurement.

Accuracy class 1.0 on request.


C Double frequency meter

The instrument is equipped with two independent reed frequency meters. (Accuracy class of 0.5 for a reed frequencymeter with range 45-55 Hz will be ± 0.5 Hz)

Dimensions, see page 33

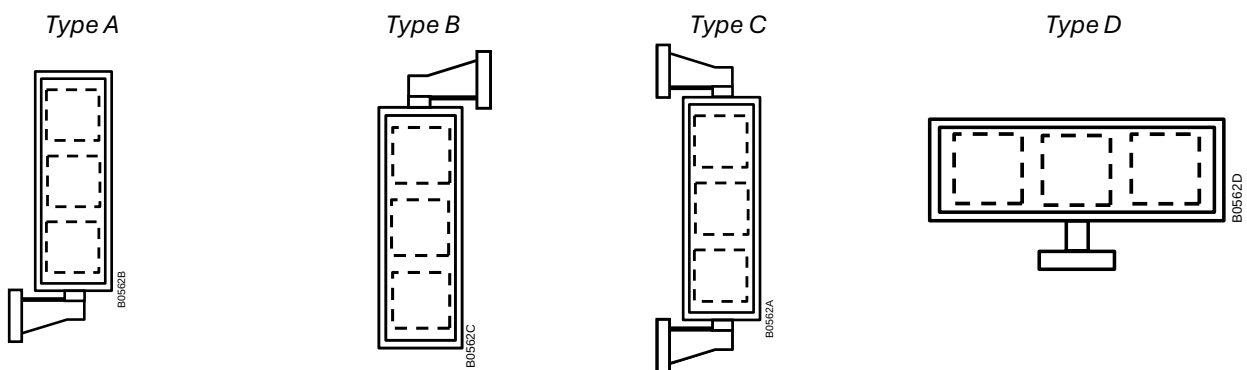




INSTRUMENT ACCESSORIES

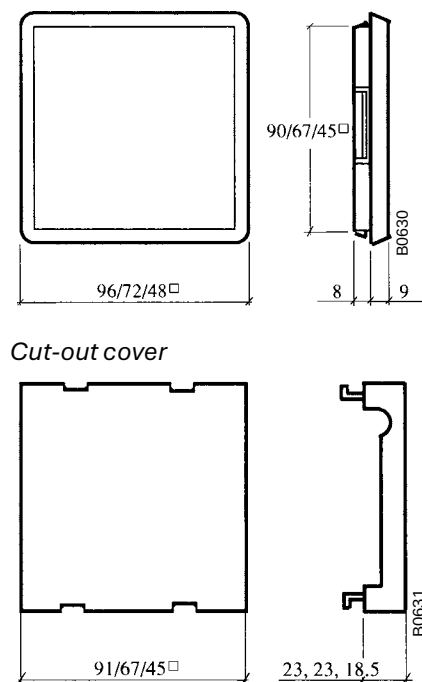

Type	For front size	Art. No.
Cut-out covers, black	96 x 96 mm	65 04 02
	72 x 72 mm	67 44 02
	48 x 48 mm	67 47 02
Protection covers	96 x 96 mm	11 19 01
	72 x 72 mm	11 29 01
	48 x 48 mm	11 39 01
Rubber seals	96 x 96 mm	16 33 00
	72 x 72 mm	17 27 00
	48 x 48 mm	16 34 00
Mounting frame^{*)}	96 x 96 mm	11 95 01
	72 x 72 mm	11 95 02
	48 x 48 mm	11 95 03




^{*)} For installation of 3 instruments in one aperture 284 x 92, 212 x 68, 141 x 45 mm respectively.

DIMENSIONS



Type	Dimensions mm			
	A	B	C	D
IQ 48, CQ 48, CQR 48	49 x 49 ¹⁾	62,5	66,5	45 x 45 +0,6
QB 48	49 x 49 ¹⁾	57,0	66,5	45 x 45 +0,6
CL 48, CLR 48	49 x 49 ¹⁾	63.5	66.5	45 x 45 +0.6
CL 72, CLR 72CQ 72, CQR 72, IQ 72, IQB 72, QB 72, FQ 72	72 x 72	63,5	67,5	68 x 68 +0,7
CL 96, CLR 96, CQ 96, CQR 96, IQ 96, IQB 96, QB 96, PFQ 13, FQ 96, FL 96	96 x 96	59,5	63,0	92 x 92 +0,8
PQ/PL 12-34, QQ/QL 13-33	96 x 96	97,0	100,5	92 x 92 +0,8



1) Mosaic performance for 48x48 on request.



Type	Dimensions mm				
	A	B	C	D	E
LSC 96KD	96 x 96	104	-	5	92 x 92 +0,8


Type	Dimensions mm				
	A	B	C	D	E
SY 96S	96 x 96	100	19	5	92 x 92+0,8
SY144S	144 x 144	103	14	7	138 x 138+1,0
WQ 96/2	96 x 96	100	15	5	92 x 92+0,8
WQ 144/2S	144 x 144	118	3	7	138 x 138+1,0
FQ 96/2	96 x 96	53	-	5	92 x 92 +0,8
FQ144/2	144 x 144	49	3	7	138 x 138+1,0

PI, PIR

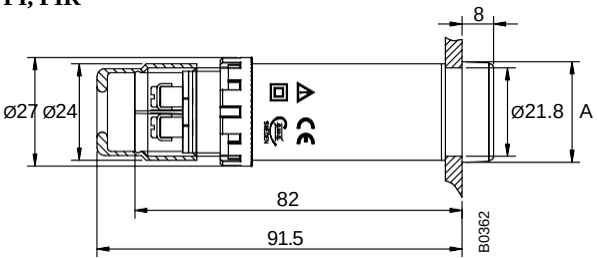

Type	A mm
PI 24, PIR 24	24 x 24
PI 25, PIR 25	25 x 25
PI 29, PIR 29	Ø 29
PI 36, PIR 36	36 x 36
PI 39, PIR 39	Ø 39


M 300-

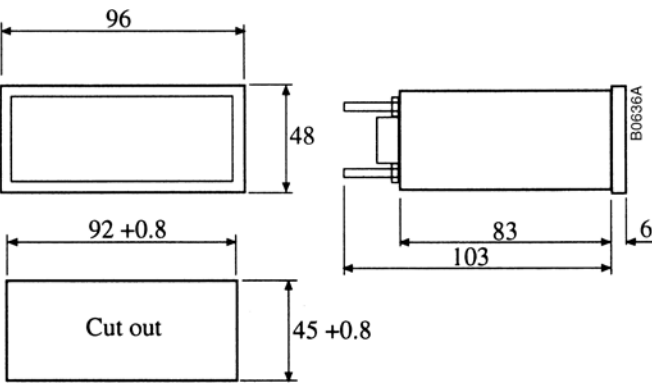


Wall brackets

form A, B

(form B: support will be mounted on upper side of wall bracket)

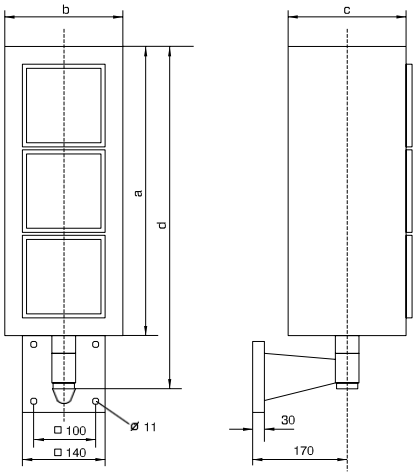


form C (WA 144 only)

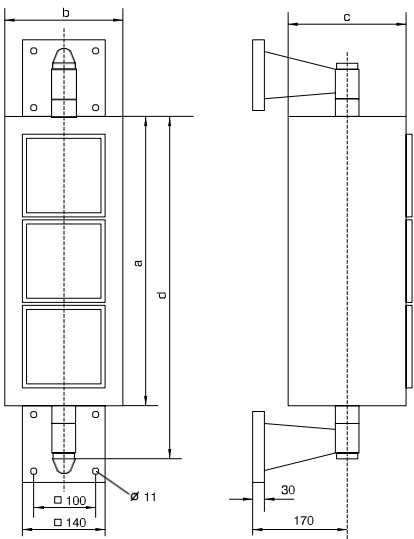

dimensions (in mm)	WA 96-A/ B
a	345
b	150
c	160
d	414

dimensions (in mm)	WA 144-A/ B/ C
a	487
b	200
c	200
d	556


form D

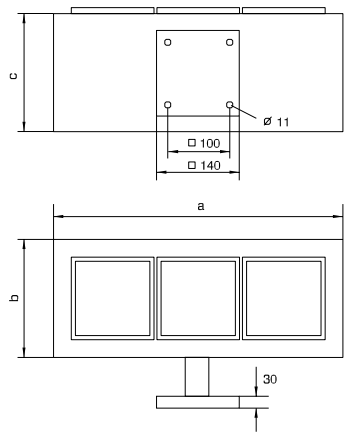


dimensions (in mm)	WA 96-D	WA 144-D
a	345	487
b	150	200
c	160	200

SCALE TYPES


Moving iron instruments

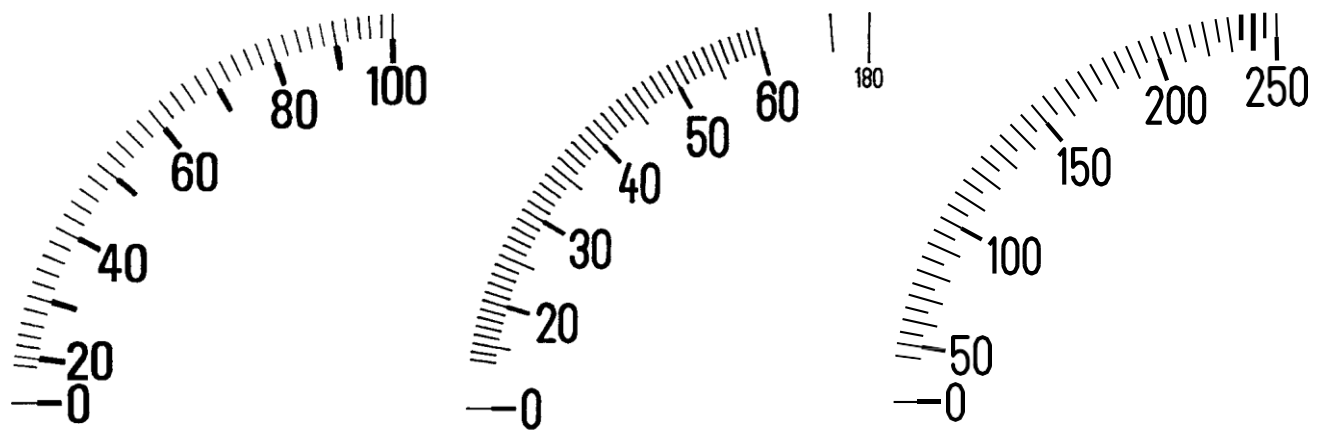


Moving coil instruments

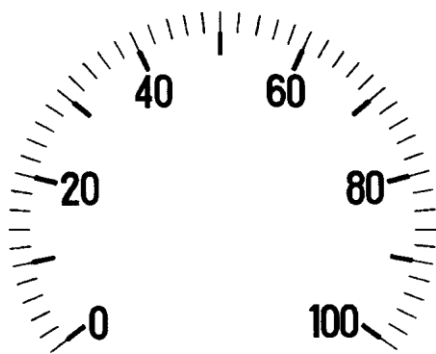

Moving coil instruments, edgewise scale

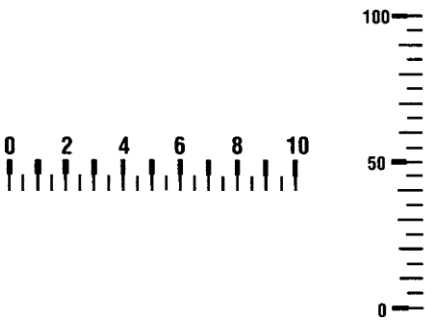

B0368C

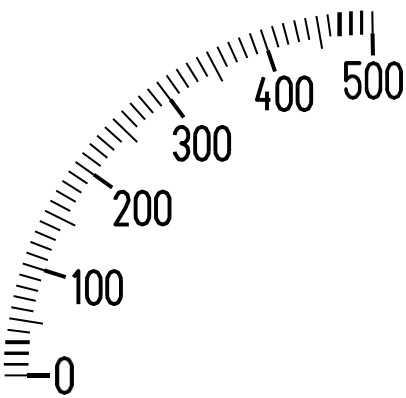

Our vision

“To be an enduring business that grows from profits earned fairly from products and services that help users save, reduce energy use, and live in comfort.”


Secure is a multi-national solutions provider for revenue management, power quality and energy efficiency that enables users to save money, reduce energy consumption and facilitate comfortable living. We began life in 1987 at the advent of the electronic age.

By combining Indian engineering with the best theoretical developments in the global metering domain, Secure was able to create India’s first economically viable energy meter. We acquired CEWE Instruments AB in 2007, and later fully merged CEWE as part of Secure. CEWE started in Sweden, and has had a long history in Europe, boasting over 100 years’ experience in metering technology.

Our 35-year journey has since taken us all over the world; our products are now installed in over 50 countries. More than 6,500 people work with us across Australia, Bangladesh, India, Italy, Singapore, Sweden, Switzerland, UAE, and the UK to build a future that is energy responsible.

We are more than a metering company

Our expertise is spread over the entire energy stream, from the generation of electricity, gas, and heat to their final consumption, adding value at every point. We create solutions for metering billing and collection, pump efficiency (ESCO), controlling heating and cooling, energy auditing, asset monitoring, older adult care, and more.

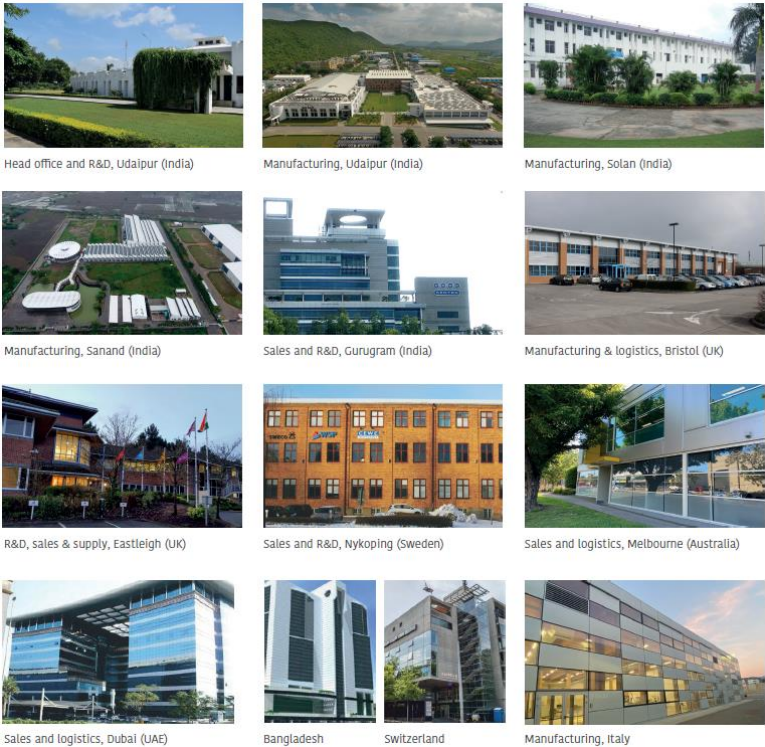

About Secure



Present in 60 countries over 5 continents



Over 6500 employees



Manufacturing facilities on three continents (Europe, Africa and Asia)



Offices in 11 sites worldwide



650 R&D engineers



50M+ meters manufactured so far

Secure Meters AB
Piazza Manifattura 1, 38068 Rovereto (TN),
Tel: +39 0464 890300
Email: sales_europe@securemeters.com
www.securemeters.com

